


FM APPROVALS
Project ID: 3026158

Appendix E

¾ or 1 Hour Fire Resistant Column

COLUMN PROTECTION METHOD 10

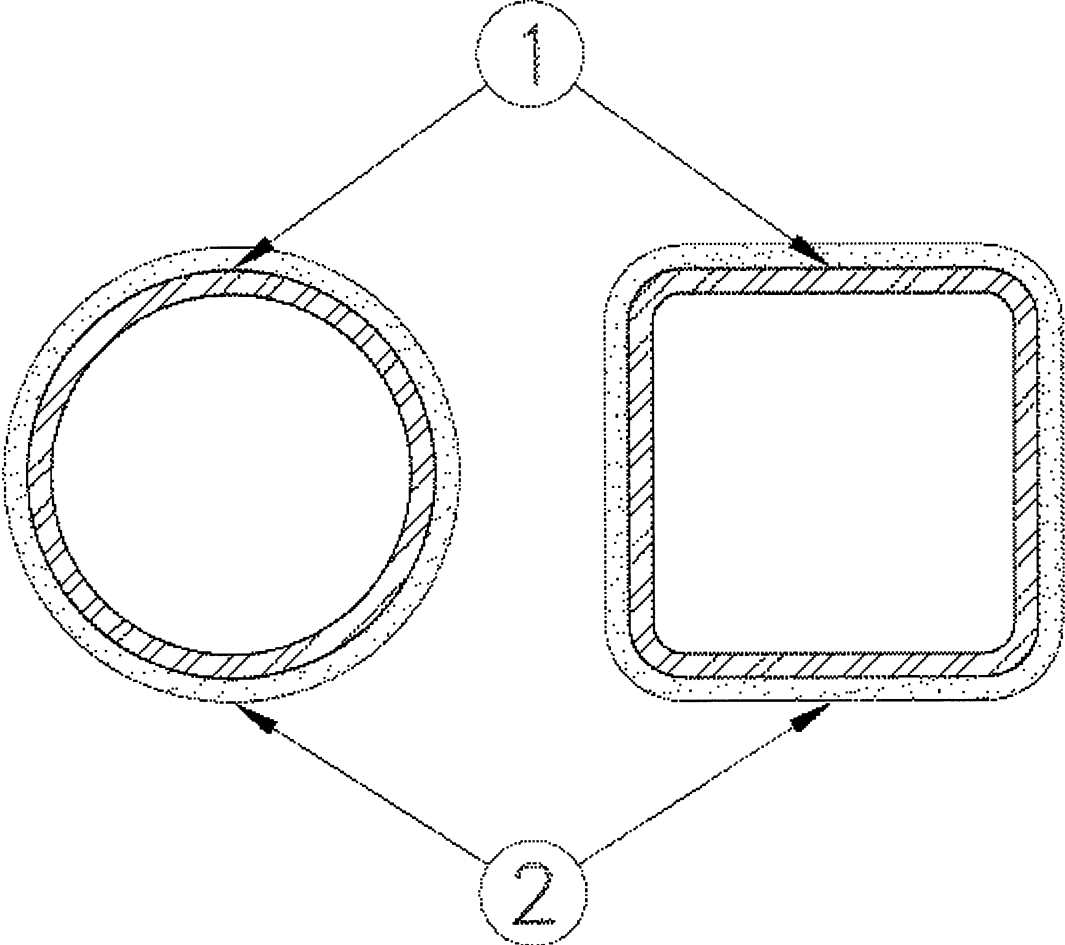

FM APPROVALS
Project ID: 3026158

Appendix E

¾ or 1 Hour Fire Resistant Column

COLUMN PROTECTION METHOD 10

1. Steel Column — Square, rectangular or circular tubular steel columns with the minimum sizes shown in the table below, or square, rectangular or circular hollow structural sections (HSS) with M/D as specified below. All columns should be free of dirt, loose scale and oily deposits.
2. Mastic Coating — Coating applied in accordance with manufacturer's instructions to the minimum dry film thicknesses shown below. Column surfaces should be primed as per manufacturer's instructions.

Ratings, hr	Min Column Size, in.	Column A/P	Min Column Size, mm	Min M/D	Required Min Film Thickness, in. (mm)
¾	ST 5 x 3 x 1/4	0.22	HSS127 x 76 x 6.4	44	0.130 (3.30)
¾	SP 8.625 dia x 1/4	0.24	HSS 219 dia x 6.4	48	0.102 (2.60)
1	ST 5 x 3 x 1/4	0.22	HSS127 x 76 x 6.4	44	0.134 (3.40)
1	SP 8.625 dia x 1/4	0.24	HSS 219 dia x 6.4	48	0.148 (3.76)

M = Mass of column section, kg/m.

D = Heated perimeter of column section, m.

A/D Fire Protection Systems Inc 420 Tapscott Road Unit 5 Scarborough Ontario M1B 1Y4
A/D FIREFILM III.

3. Top Coat — (Not shown) — Finishing topcoat, (silicone alkyd paint) applied at an approximate 0.002 in. (0.05 mm) dry film thickness.

A/D Fire Protection Systems Inc 420 Tapscott Road Unit 5 Scarborough Ontario M1B 1Y4
A/D COLORCOAT.