


UL Design No. X639

December 06, 2005

Rating - 3 Hr

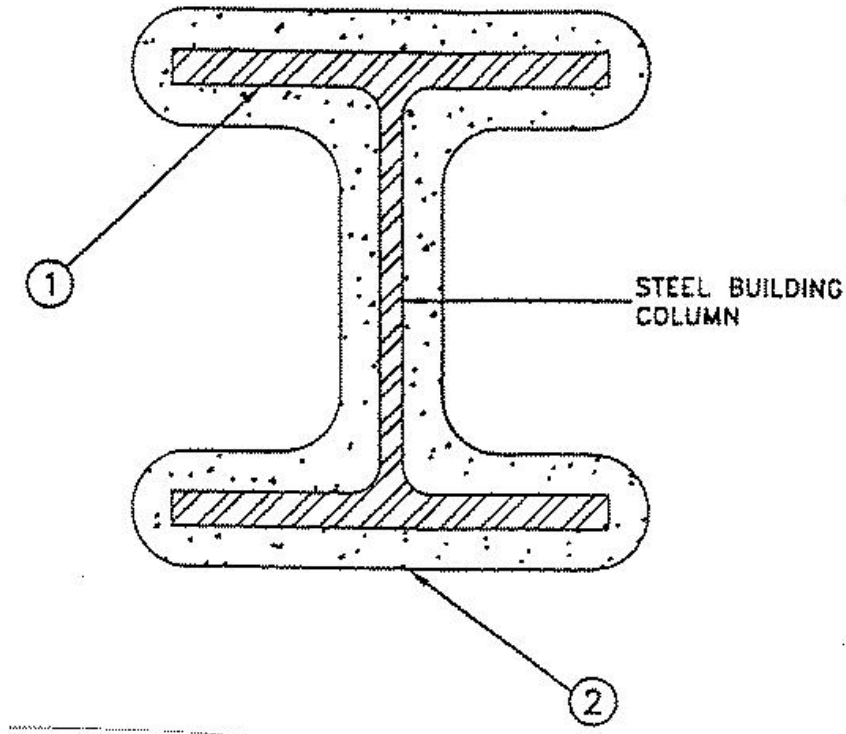

1. **Steel Column** — Minimum size column W12 x 170 with $W/D \geq 2.26$. The column surfaces shall be free of dirt, loose scale and oil.

2. **Mastic Coating*** — Coating applied in accordance with manufacturer's instructions to the minimum dry film thickness of 0.130 in.

A/D FIRE PROTECTION SYSTEMS INC — Types "A/D FIREFILM II" and "A/D FIREFILM III". Investigated for Interior Conditioned Space Purpose and Interior General Purpose.

3. **Top Coat** — (Not Shown) — Finishing topcoat, Type "A/D COLORCOAT", silicone alkyd paint applied at an approximate 0.002 in. dry film thickness.

*Bearing the UL Classification Mark