


UL Design No. X670

December 15, 2005

Ratings- 3 Hr (See Item 2)

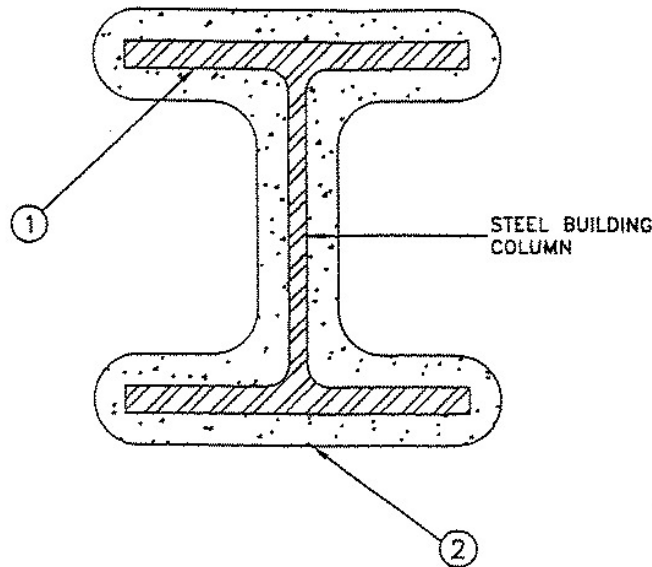

1. **Steel Column** — Wide flange steel columns with the minimum sizes shown in the table below. Columns shall be free of dirt, loose scale and oil.

2. **Mastic Coating*** — Coating applied in accordance with manufacturer's instructions to the minimum dry film thickness shown below:

Rating, hr	Column Description, In.	Column W/D	Required Min Thickness, In.
3	W10x77	1.28	0.269

A/D FIRE PROTECTION SYSTEMS INC — Type "A/D FIREFILM III" investigated for Interior Conditioned Space Purpose and Interior General Purpose.

3. **Top Coat** — (Not shown) — Finishing topcoat, Type "A/D COLORCOAT" silicone alkyd paint applied at an approximate 0.002 in. dry film thickness.

*Bearing the UL Classification Mark