


**ULC DESIGN No. Z612**

**Ratings – 1-1/2, 2 h (See Item 2)**

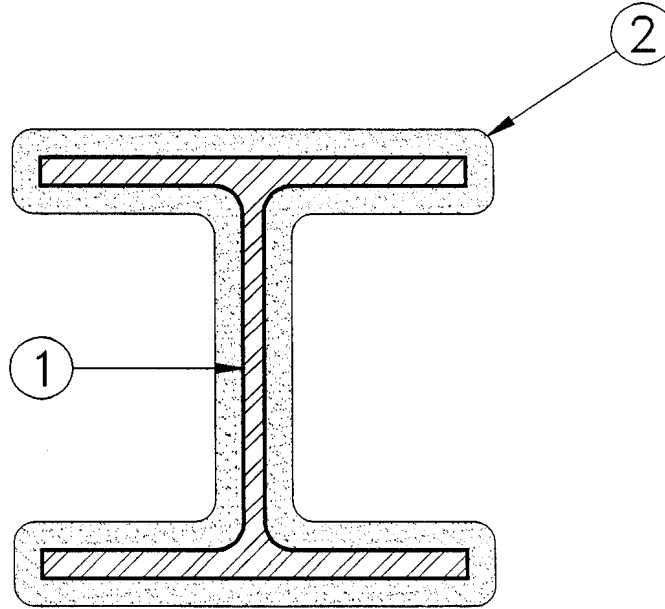

**1. Steel Column – W-shaped as indicated below.**

- **2. Thin-Film Intumescent Coatings –** (Guide No. 40 U18.12.9). Intumescent coating designated "A/D FIREFILM II" or "A/D FIREFILM III" applied in accordance with manufacturer's instructions to the minimum dry film thickness shown below.

Rating, h	Column Description, mm	Column M/D	Required Min Thickness, mm
1-1/2	W 200 x 46, W 250 x 49	38	5.4
2	W 310 x 179	95.2	2.4

A/D FIRE PROTECTION SYSTEMS INC.

**3. Finish Coating** (not shown) - Silicone alkyd paint designated "A/D COLORCOAT".