



FIREBARRIER MINERAL WOOL

1. PRODUCT NAME

A/D FIREBARRIER Mineral Wool

2. PRODUCT DESCRIPTION

Pre-formed, semi-rigid, non-combustible mineral wool insulation. The mineral wool is pre-cut into 48 in. (1220 mm) lengths and is available in various depths and widths for immediate installation.

Basic Use: A/D FIREBARRIER Mineral Wool is intended for use as a firestop system component and forming material in tested firestop systems and designs. It is friction fitted into openings, joints, gaps, spaces and voids in fire rated assemblies. It is usually used in conjunction with firestop sealant products such as A/D FIREBARRIER Silicone, Silicone SL, Seal, Seal NS Acrylic Sealant and Intumescent Sealant.

Composition and Materials:

A/D FIREBARRIER Mineral Wool is a noncombustible semi-rigid combination of basaltic mineral wool and proprietary binders.

Packaging: A/D FIREBARRIER Mineral Wool is available in 25-lb (11 kg) nominal weight polyethylene bags. Pre-cut to required width and depth, the 48 in. (1220 mm) strips allow for ease of handling and installation. Refer to Estimating Guide for size availability.

Color: Brown

Standards: A/D FIREBARRIER Mineral Wool has been tested in accordance with:

- CAN4-S114, "Standard Method of Test For Determination of Non-combustibility In Building Materials"
- ULC-S115-95, Standard Method of Fire Tests of Firestop Systems"
- ANSI / UL 1479 and ASTM E814, "Standard Method of Fire Tests of Through-Penetration Fire Stops"

Table 1 - Physical Properties	
Property	Result
Density	Nominal 4 lb./ft ³ (64 kg/m ³)
Moisture Adsorption	< 1%; inorganic, will not mildew
Service Temperatures	Continuous to 1200F (649C)
Linear Shrinkage	0% @1050°F (551°C); <1% @1200°F(649°C)
Recovery after 10% compression	100%
Asbestos	None
Surface Burning, CAN4-S102, ASTM E84 & UL723	Flame Spread – 5; Smoke Developed – 0
Non-combustibility, CAN4-S114	Listed as noncombustible by ULC
Non-Corrosive, NRC 1.36, ASTM C692, C795 & C871	Will not cause or contribute to corrosion

- UL 2079, "Standard Method of Tests For Fire Resistance of Building Joint Systems."

3. TECHNICAL DATA

Refer to Table 1 - Physical properties.

For details of rated firestop systems, see ULI' s Fire Resistance Directory, Volume 2, ULC' s List of Equipment and Materials, Firestop Systems and Components, ITS' s Directory of Listed Products and Factory Mutual' s Approval Guide.

A/D FIREBARRIER Mineral Wool is nominal 4 lb/ft³ (64 kg/m³) and complies with the requirements of our UL tested firestop systems where generic mineral wool is referenced.

4. INSTALLATION

Install A/D FIREBARRIER Mineral Wool to the minimum 25% or 33% compression required by the tested firestop system - see Table 2. Compression must always be perpendicular to the grain. Butt adjacent sections of A/D FIREBARRIER Mineral Wool tightly against each other. Leave no voids. A/D FIREBARRIER Mineral Wool is the recommended backup material

for A/D FIREBARRIER Silicone, Silicone SL, Seal, Seal NS, Acrylic Sealant and Intumescent Sealant. Determine the depth of firestop sealant required, and recess the A/D FIREBARRIER Mineral Wool the appropriate depth.

Precautions: To safely use this product, read and abide by the Material Safety Data Sheet (MSDS). Avoid inhalation of dust during use. Avoid skin and eye contact. Mineral Wool fibre, like other nuisance particulates, may cause itching and possible irritation of eyes and/or upper respiratory tract.

5. AVAILABILITY AND COST

Availability: A/D sales offices and technical representatives are located throughout North America.

6. MAINTENANCE


No maintenance should be needed. If the mineral wool becomes damaged, replace damaged section.

7. TECHNICAL SERVICES

Contact nearest A/D office.


Table 2 - Thickness and Compression Data					
Nominal Batt Thickness,		Maximum Width of Opening for 25% compression, in. (mm)		Maximum Width of Opening for 33% compression, in. (mm)	
in.	mm	in.	mm	in.	mm
1	25	3/4	19	5/8	17
1.5	38	1-1/8	29	1	25
2	50	1-1/2	38	1-5/16	34
3	75	2-1/4	57	2	51
4	100	3	75	2-5/8	68
5 (4 + 1)	125 (100 + 25)	3-3/4	95	3-5/16	85
5.5 (4 + 1.5)	140 (100 + 38)	4-1/8	105	3-5/8	94
6 (4 + 2)	150 (100 + 50)	4-1/2	114	4	100
7 (4 + 3)	175 (100 + 75)	5-1/4	133	4-5/8	119
8 (4 + 4)	200 (100 + 100)	6	150	5-5/16	136

CORRECT

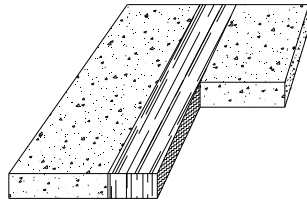

Always install A/D FIREBARRIER Mineral Wool so that it is compressed perpendicular to the grain.

INCORRECT

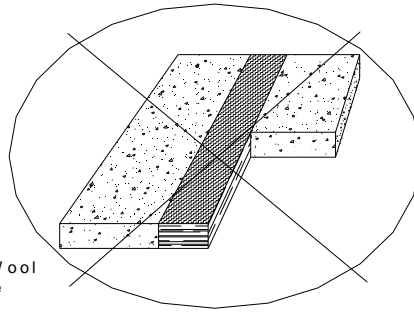

AD FIRE PROTECTION SYSTEMS
part of the **Carboline Company**

Head Office: 420 Tapscott Rd., Scarborough, Ontario M1B 1Y4

Tel: 800-263-4087 or 416-292-2361 Fax: 416-298-5887

www.adfire.com

Warnock Hersey



ISO 9001
REGISTERED COMPANY