


Through-penetration Firestop Systems
UL System No. C-AJ-1559
F Rating - 3 Hr
T Rating - 3/4 Hr

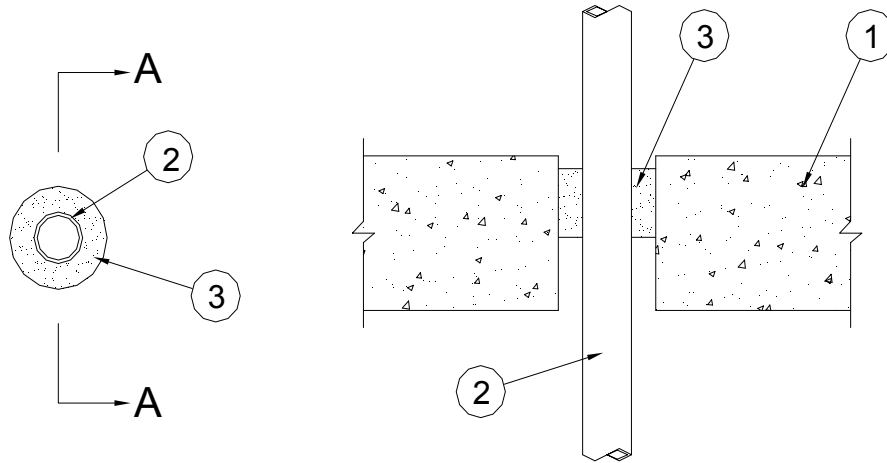

SECTION A-A

- 1. Floor or Wall Assembly** - Min. 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf (1600-2400 kg/m³)) structural concrete. Floor may also be constructed of any min. 6 in. (152 mm) thick UL Classified hollow-core **Precast Concrete Units***. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max. dia. of opening is 3 in. (76 mm).

See **Precast Concrete Units** (CFTV) and **Concrete Block** (CAZT) categories in the Fire Resistance Directory for names of manufacturers.

- 2. Through Penetrants** - One metallic pipe, conduit or tubing to be installed within the firestop system. The annular space shall be min. 3/8 in. (10 mm) to max. 3/4 in. (19 mm). Pipe, conduit or tubing to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:

A. **Steel Pipe** - Nom. 1-1/2 in. (38 mm) dia. (or smaller) Schedule 10 (or heavier) steel pipe.

B. **Conduit** - Nom. 1-1/2 in. (38 mm) dia. (or smaller) steel electrical metallic tubing or rigid steel conduit.

- 3. Fill, Void or Cavity Material* - Putty** - Min. 2 in. (51 mm) thickness of fill material applied within the annulus, recessed 1/4 to 3/8 in. (6 to 10 mm) from top surface of floor or both surfaces of wall. In floors constructed of hollow-core precast concrete units, fill material to be installed flush with both surfaces of assembly.

A/D FIRE PROTECTION SYSTEMS INC - A/D FIREBARRIER Putty II

*Bearing the UL Classification Mark