


System No. C-AJ-0067

November 29, 1999

F Rating — 3 Hr.

T Rating — 2 Hr.

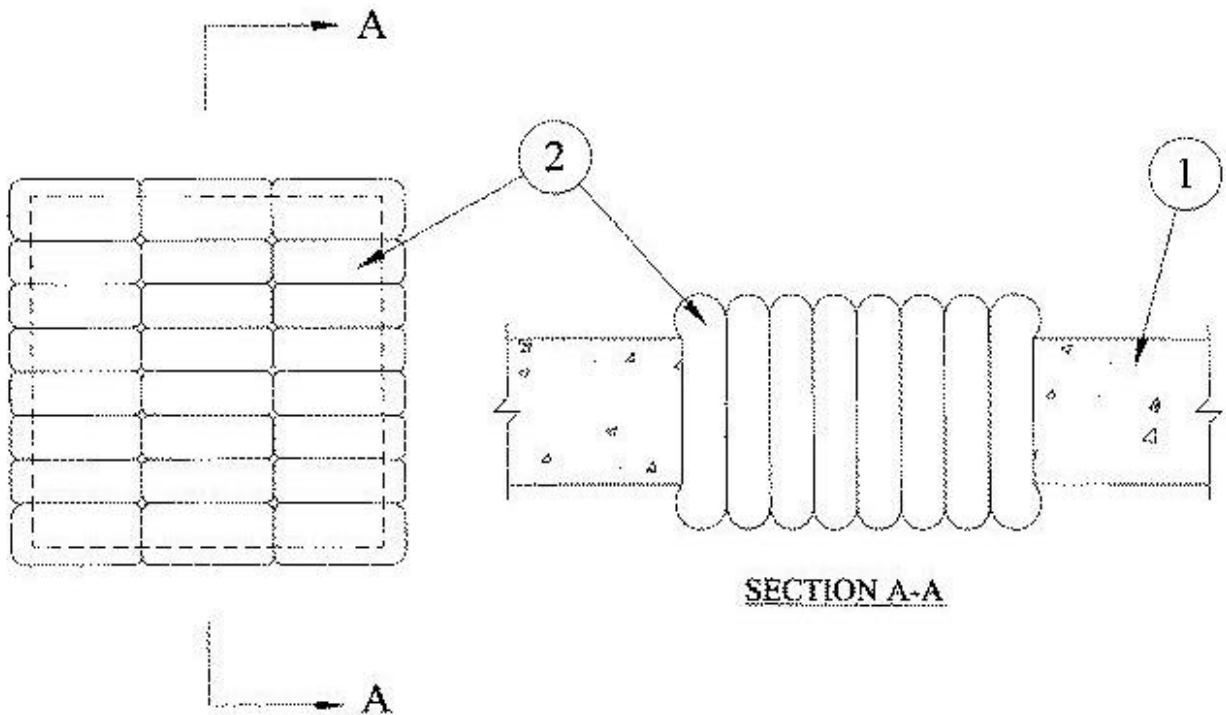

1. **Floor or Wall Assembly** Min 5 in. thick reinforced normal weight (140-150 pcf) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max area of opening is 144 sq in. with max dimensions of 12 in.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Fill, Void or Cavity Materials***— **Pillows** Nom 8 in. long by 4 in. wide by 2 in. thick pillow-like material. Pillows shall be tightly packed into opening. Pillows installed with 8 in. dimension projecting through floor or wall and centered within the opening.

A/D FIRE PROTECTION SYSTEMS INC —
A/D FIREBARRIER Pillows

*Bearing the UL Classification Marking