


**UL System No. C-AJ-2150**

July 28, 2003

**F Rating — 2 Hr**

**T Ratings — 1 and 2 Hr (See Item 3)**

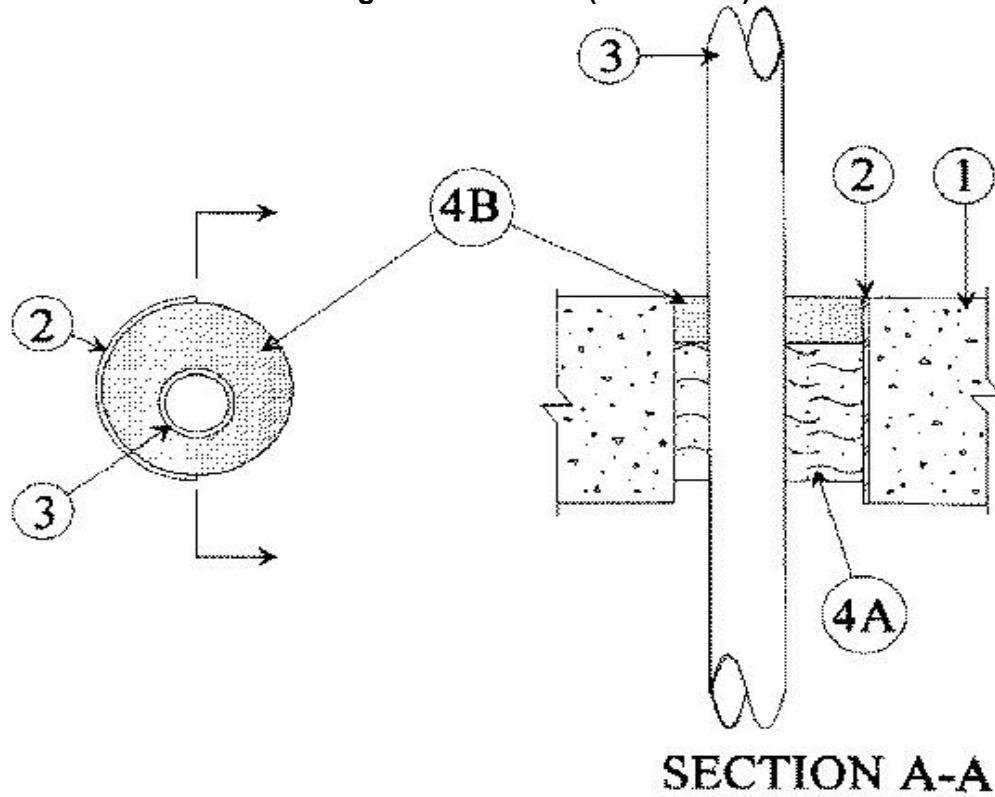

**1. Floor or Wall Assembly** — Min 4-1/2 in. thick reinforced normal weight (100-150 pcf) concrete floor or min 5-1/2 in. thick reinforced normal weight concrete wall. Wall may also be constructed of any UL Classified **Concrete Blocks\***. Max diam of opening is 4-1/2 in.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

**2. Metallic Sleeve** — (Optional) — Nom 4 in. diam (or smaller) Schedule 40 (or heavier) steel sleeve cast or grouted into floor or wall assembly, flush with floor or wall surfaces. The use of the steel sleeve is dependent upon the nom diam of the through penetrant as tabulated in Item 3.

**3. Through Penetrants** — One nonmetallic pipe, conduit or tubing to be installed either concentrically or eccentrically within the firestop system. The annular space between the pipe, conduit or tubing and the periphery of the opening shall be a min of 3/4 in. to a max 1-3/8 in. Pipe, conduit or tubing to be rigidly supported on both sides of floor or wall. The following types and sizes of pipes, conduits or tubing may be used:

**A. Polyvinyl Chloride (PVC) Pipe** — Nom 2 in. diam (or smaller) Schedule 40 solid core PVC pipe for use in closed (process or supply) or vented (drain, waste, or vent) piping systems.

**B. Chlorinated Polyvinyl Chloride (CPVC) Pipe** — Nom 2 in. diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.

**C. Rigid Nonmetallic Conduit+** — Nom 2 in. diam (or smaller) Schedule 40 PVC conduit installed in accordance with Article 347 of the National Electrical Code, (NFPA No. 70).

See **Rigid Nonmetallic Conduit** (DZYR) category in the Electrical Construction Material Directory for names of manufacturers.

**D. Electrical Nonmetallic Tubing** — (ENT)+ Nom 1-1/2 in. diam (or smaller) **Electrical Nonmetallic Tubing** . ENT installed in accordance with Article 331 of the National Electrical Code (NFPA No. 70).

See **Electrical Nonmetallic Tubing** (FKHU) category in the Electrical Construction Material Directory for names of manufacturers.

The T Rating of the firestop system is dependent upon the use of the steel sleeve and the max diam of the through penetrant as tabulated below:

<b>Use of Steel Sleeve</b>	<b>Max Diam of Through Penetrant In.</b>	<b>T Rating Hr</b>
Optional	1-1/2	1
Not permitted	2	2

**4. Firestop System** — The firestop system shall consist of the following:

**A. Packing Material** — Min 3-1/2 in. thickness of min 4 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces of wall as required to accommodate the required thickness of fill material.

**B. Fill, Void or Cavity Material\* — Sealant** — Min 1 in. thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall.

**A/D FIRE PROTECTION SYSTEMS INC** — A/D FIREBARRIER Silicone SL (floors only) and A/D FIREBARRIER Silicone (floors and walls)

\*Bearing the UL Classification Marking

+Bearing the UL Listing Mark