

BXUVC.F906
Fire-resistance Ratings

[Page Bottom](#)

BXUVC - Fire-resistance Ratings

[See General Information for Fire-resistance Ratings](#)


Design No. F906

June 10, 2015

Restrained Assembly Rating - 3, 2, 1-1/2 & 1 h (See Item 4)

Unrestrained Assembly Rating - 0 h (See Item 3)

Unrestrained Beam Rating - 3/4, 1 & 1-1/2 h (See Item 4)

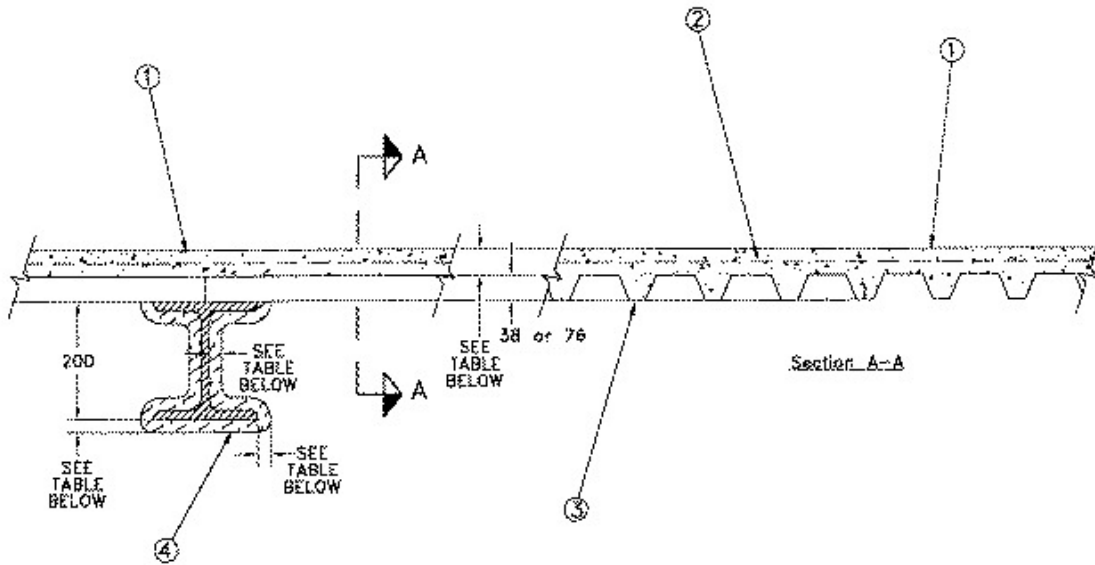

Beam — W200x42, min size. (For Spray-Applied Fire-Resistive Material, see Item 4a or b);

Beam — W150x18 and W150x37, min size. (For Thin-Film Intumescent Coating, see Item 4c).

1. **Normal-Density or Low-Density Concrete** — Normal-density concrete, carbonate or siliceous aggregate, 2400±50 kg/m³ density, 24 MPa nom compressive strength. Low-density concrete, expanded shale, clay or slate aggregate by rotary kiln method, 1760±50 kg/m³ density, 24 MPa nom compressive strength, or, expanded blast furnace slag aggregate, 1955±50 kg/m³ density, 24 MPa nom compressive strength.

2. **Wire Fabric** — 152 by 152 MW9.1xMW9.1 wire mesh.

3. **Steel Floor Units** — (CHWXC). Composite or noncomposite floor units. Any combination of 0.76 mm thick fluted sections or 0.91/0.91 mm thick cellular sections, welded to supports with 19 mm puddle welds spaced 300 mm OC. Adjacent units button punched or welded 915 mm OC along side joints. When the max clear span of the steel floor units is less than or equal to the tested span of 2900 mm, the unrestrained assembly rating is increased to 3/4 h, 1 h or 1-1/2 h to match the unrestrained beam rating.

See individual manufacturer's listing for those profiles that may be used in this Design.

AGWAY METALS INC

GROUPE CANAM INC

NEW MILLENNIUM BUILDING SYSTEMS L L C

VICWEST INC

VULCRAFT, DIV OF NUCOR CORP

WESTFORM METALS

4(a). **Spray-Applied Fire-Resistive Material** — (CHPXC). Fibre material applied to min W200x42 steel beam surfaces that are clean and free of dirt, loose scale or oily deposits. Applied to the thickness indicated below. When fluted steel floor units are used, the space between the units and top flange of the beam shall be filled. Fibre to have a min average dry density of 165 kg/m³ with no individual value less than 145 kg/m³. For method of density determination, refer to General Information Section under heading "Fire Resistance Ratings".

A/D FIRE PROTECTION SYSTEMS INC

Restrained Assembly Rating, h	Unrestrained Assembly Rating, h	Unrestrained Beam Rating, h	Min Concrete Cover Thickness, mm		Min Thickness of Spray-Applied Fire-Resistive Material on Beam, mm
			Normal-Density	Low-Density	
3	0 (see Item 3)	1-1/2	140	110	22
2	0 (see Item 3)	1	114	85	13
1-1/2	0 (see Item 3)	1	100	71	13
1	0 (see Item 3)	1	83	64	13

OR

4(b). **Spray-Applied Fire-Resistive Material** — (see table below) — (CHPXC). "A/D Type 5" spray-applied fire-resistive material for application with or without adhesive to steel surfaces in thicknesses indicated above and in the following table (fluted units only). Mixture to have a min average dry density of 272 kg/m³ with a min individual value of 248 kg/m³. Area between fluted and top flange of beam to be filled. For method of density determination, refer to General Information Section under heading "Fire Resistance Ratings". Steel surfaces must be clean and free of dirt, loose scale and oily deposits.

A/D FIRE PROTECTION SYSTEMS INC

Restrained Assembly Rating, h	Unrestrained Assembly Rating, h	Unrestrained Beam Rating, h	Min Concrete Cover Thickness, mm		Min Thickness of Spray-Applied Fire-Resistive Material on Beam, mm
			Normal-Density	Low-Density	
3	0 (see Item 3)	1-1/2	140	110	22
2	0 (see Item 3)	1	114	85	13
1-1/2	0 (see Item 3)	1	100	71	13
1	0 (see Item 3)	1	83	64	13

4(c). **Thin-Film Intumescent Coatings** — (CAVCC). Intumescent coating designated "A/D FIREFILM II", "A/D FIREFILM III" or "A/D FIREFILM III C" applied to steel beams in accordance with manufacturer's instructions to the min dry film thicknesses shown below:

A/D FIRE PROTECTION SYSTEMS INC

Minimum Beam Size and Minimum (M/D) Ratio	Restrained Assembly Rating, h	Unrestrained Assembly Rating, h	Unrestrained Beam Rating, h	Min Concrete Cover Thickness, mm		Min Dry Thickness of A/D Firefilm II, III or III C on Beam, mm
				Normal-Density	Low-Density	
W200 x 46 (46)	2	0 (see Item 3)	1	114	85	1.65
W150x18 (30)	1-1/2	0 (see Item 3)	1	100	71	1.65
W150x18 (30)	1	0 (see Item 3)	1	83	64	1.65
W150x18	3/4	0 (see Item 3)	3/4	83	64	1.14

5. **Shear Connectors** — (optional) (not shown) — Studs 13 mm diam by 100 mm long, headed type. Welded to top flange of beam through steel floor units.

Last Updated on 2015-06-10

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

Copyright © 2015 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2015 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

