

BXUVC.I800
Fire-resistance Ratings

[Page Bottom](#)

Fire-resistance Ratings

[See General Information for Fire-resistance Ratings](#)

Design No. I800


October 03, 2002

Restrained Assembly Rating - See Item No. 4

Unrestrained Assembly Rating - See Item No. 4

Unrestrained Beam Rating - See Table 1

Load Restricted — Assembly evaluated in accordance with Working Stress Design methods, for use under Limit States Design methods; refer to information under Guide BXUVC.

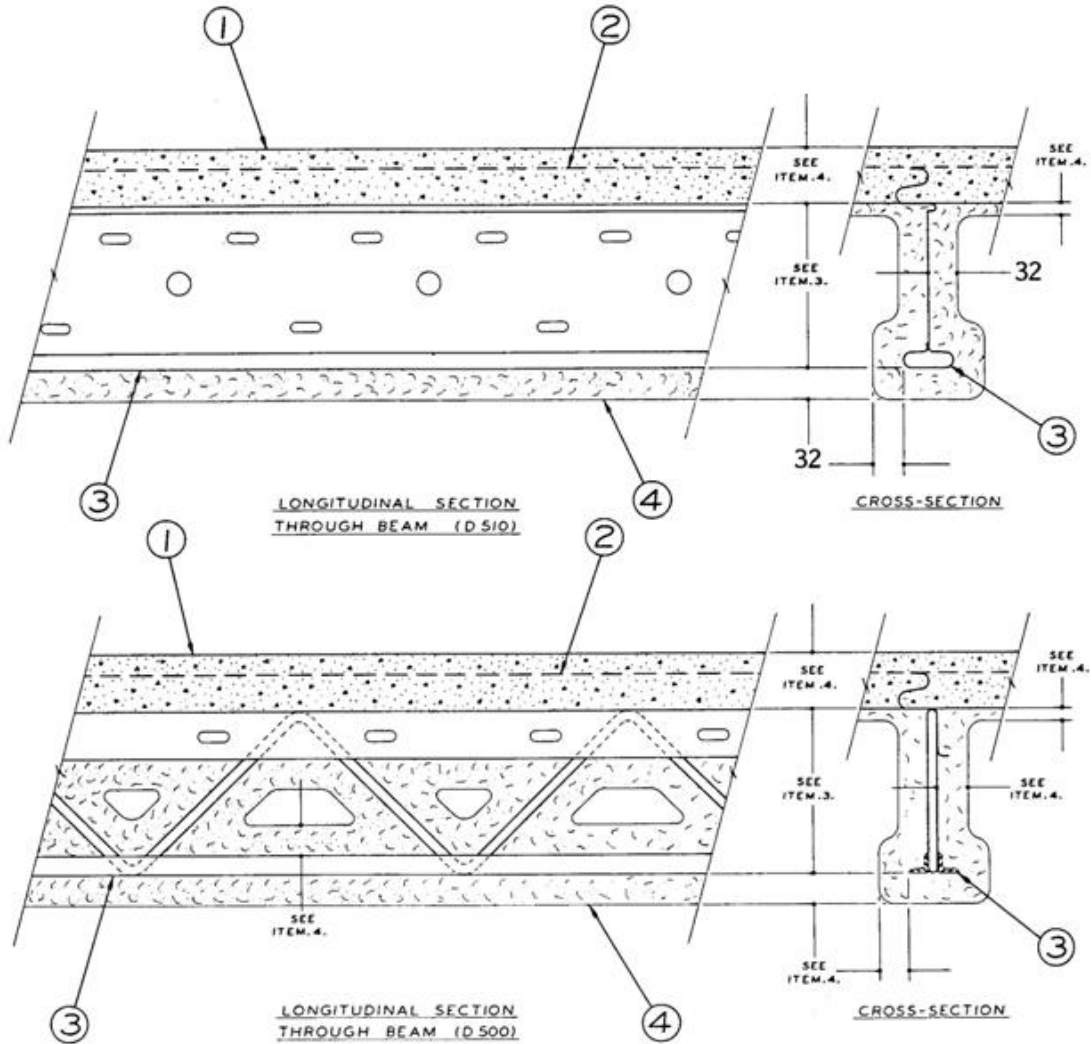

1. **Sand-Gravel Concrete** — $2400 \pm 50 \text{ kg/m}^3$, 24 MPa nominal compressive strength.

2. **Wire Fabric** — 152x152 P13.3/P13.3 steel wire.

3. **Structural Component** — (CIZTC). Steel Joist. H1004 or H675, 6 kg/m minimum size joists. Profiles as indicated in drawing details. As an option to the H1004 and H675 joists, MD2000 (minimum weight of 9.75 kg/m) and Mini 2000 (minimum weight of 5.7 kg/m) joists may be used for long and short spans respectively.

When the MD2000 or Mini 2000 joists are used, Canam Murox Type M-156R fluted steel floor units or equivalent (minimum 24 gauge - nominal 0.61 mm) shall be used as permanent forms for the concrete floor. The same thickness of spray-applied fire-resistive material as applied to the concrete slab and as specified in Table 2 shall be applied to the deck underside.

HAMBRO INTERNATIONAL (STRUCTURES) LTD

4. **Spray-Applied Fire-Resistive Material** — (see table 2) - (CHPXC). Applied with or without adhesive to steel and concrete surfaces to thicknesses indicated below. Fibre to have a minimum average dry density of 165 kg/m³ with no minimum individual value less than 144 kg/m³. Fibre may be tamped or untamped. Where the 89 mm thick concrete slab is not required to be sprayed, the slab shall be oversprayed a minimum width of 300 mm either side of beam or joist with a minimum fibre thickness of 7 mm. For method of density determination, refer to General Information Section, under heading "Fire Resistance Ratings". Concrete and steel surfaces to be clean and free of dirt, loose scale and oily deposits.

A/D FIRE PROTECTION SYSTEMS INC

| Unrestrained Beam Rating, h | | Description of Beam | | | |
|-------------------------------|---------------------------------|--|----------------|--------------------------------------|-------------------------------------|
| 1 | | H1004 ("D500") or H675, 6 kg/m (D"510") minimum size, or MD2000 (minimum weight of 9.75 kg/m), designed in accordance with the relevant provisions of Chapter 4 of the Supplement to the National Building Code of Canada. | | | |
| 1 and 1-1/2 (See Item No. 4) | | H1004 ("D500") minimum size, or MD2000 (minimum weight of 9.75 kg/m), designed in accordance with the relevant provisions of Chapter 4 of the Supplement to the National Building Code of Canada. | | | |
| | | Thickness of Spray-Applied Fire- Resistive Material on | | | |
| Restrained Assembly Rating, h | Unrestrained Assembly Rating, h | Unrestrained Beam Rating, h | D510 Joist, mm | D500, MD2000, or Mini 2000 Joist, mm | Concrete Slab or Steel Floor Units* |
| 2 | — | 1 | 32 | 29 | See Table Below |
| 1-1/2 | — | 1 | 32 | 29 | See Table Below |
| — | 1-1/2 | 1-1/2 | — | 38 | See Table Below |
| 1 | 1 | 1 | 32 | 29 | See Table Below |
| Concrete Slab Thickness, mm | | Min Spray-Applied Fire-Resistive Material Thickness on Slab, mm Assembly Rating: | | | |
| | | 1 h | 1-1/2 h | 2 h | |
| 63 | | 13 | 14 | | 22 |
| 70 | | 13 | 13 | | 21 |
| 76 | | 13 | 13 | | 16 |
| 89 | | 0 | 13 | | 13 |

* See Item 3.

Last Updated on 2002-10-03

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

Copyright © 2015 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2015 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

