

**BXUVC.Z807
Fire-resistance Ratings**

[Page Bottom](#)


Fire-resistance Ratings

[See General Information for Fire-resistance Ratings](#)

Design No. Z807

March 23, 2004

Rating - See Table Below

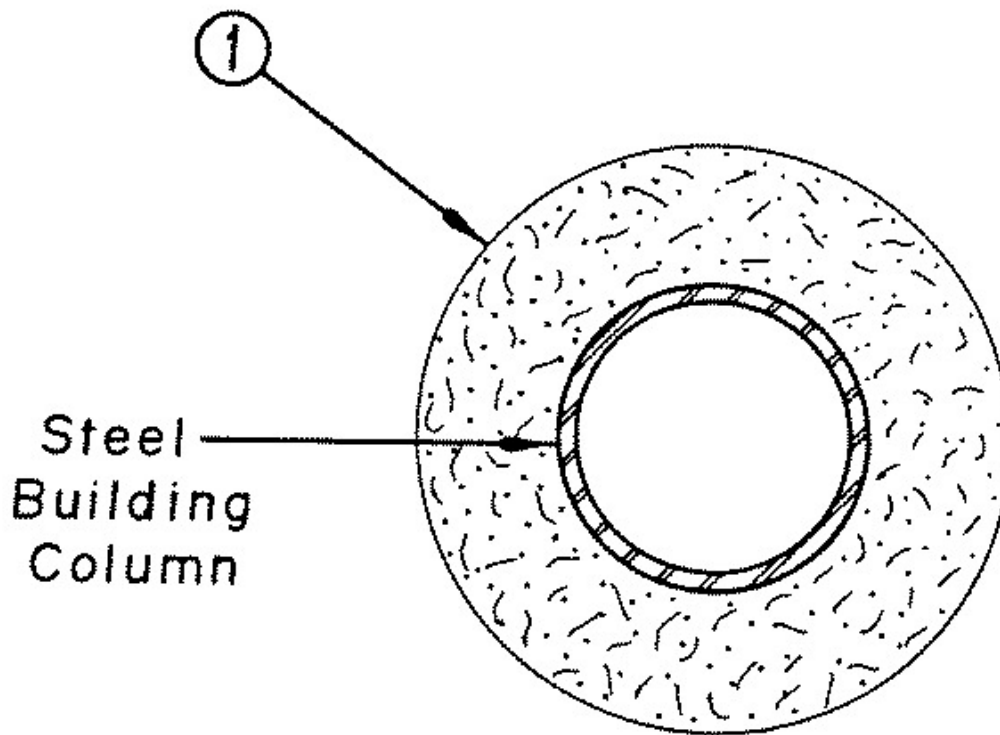

Steel Building Column — Minimum size of pipe column 114.3 mm outside diameter with 6.4 mm wall thickness and mass of 16.9 kg/m.

1(a). **Spray-Applied Fire-Resistive Material** — (CHPXC). Applied to column surfaces which are clean and free of dirt, loose scale and oily deposits by spraying with water to thicknesses shown in Table. Minimum average dry density of 165 kg/m³ with no individual values less than 148 kg/m³. For method of density determination, refer to General Information Section under heading "Fire Resistance Ratings".

A/D FIRE PROTECTION SYSTEMS INC

Rating, h	Min Required Thickness of Spray-Applied Fire-Resistive Material, mm
1	31
1-1/2	49
2	59

Alternatively, required thicknesses may be determined for $36.2 \leq M/D \leq 187.5$ by the following equations:

or

$$T/PV = 0.215 (M/D) + 2.00$$

$$t = \frac{T \times 1000}{0.215(M/D) + 2.00}$$

Where:

t = required thickness, mm

T = rating period, minutes (240 minutes maximum)

PV = protection value, kg/m²

M = mass of column section, kg/m with $36.2 \leq M/D \leq 187.5$

D = heated perimeter of column section, m

d = density, kg/m³ ($125 \text{ kg/m}^3 \leq d \leq 285 \text{ kg/m}^3$)

Thickness should not be reduced below the lesser of 13 mm or the thickness indicated in the particular design.

OR

- 1(b). **Spray-Applied Fire-Resistive Material** — (see table below) - (CHPXC). A/D "Type 5" spray-applied fire-resistive material for application to steel surfaces in thicknesses indicated in the following table. Mixture to have a minimum average dry density of 272 kg/m³ with minimum individual density measurements no less than 248 kg/m³. For method of density measurements, refer to General Information Section under heading "Fire Resistance Ratings". Steel surfaces must be clean and free of dirt, loose scale and oily deposits.

A/D FIRE PROTECTION SYSTEMS INC

Rating, h	Min Required Thickness, mm
1	31
1-1/2	49
2	59

Last Updated on 2004-03-23

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

Copyright © 2015 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2015 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

